

17343-124

Fire and Overheat Detector

F-03-001
May 2025

DESCRIPTION

The Fire/Overheat Detector is a normally open device that helps to monitor fire and overheat conditions. It can be used in locations with high ambient temperatures.

The detector is made from welded stainless steel and is completely sealed. It is not repairable and cannot be disassembled. The detector is set to a specific alarm temperature when it is made at the factory and the temperature cannot be adjusted.

The detector electrically connects to its related equipment through two terminal posts with internal threads. Stainless steel screws attach the wiring from the related equipment to the two terminals. The detector mechanically attaches to the monitored area by 3/4-14 National Pipe Thread (NPT) located on the head of the detector. The temperature setting of the detector is marked on the hex body. See Figure 1 in the Outline Drawing for 17343-124 section for details.



AGENCY APPROVALS FOR 17343-124

Agency	File Number	Rating	Agency Marking
CSA	1641537	Class I, Division 1, Group B, C, D	CSA
UL	E139663	Class I, Division 1, Group B, C, D	UL
UL	S4968	Heat Actuated Device for Special Applications	
ATEX	ITS03ATEX41211U	II 3G Ex nC IIC Gc	ATEX
IEC Ex	IECEXETL12.0008U	Ex nC IIC	CE
CE (Intertek)	101404110BOX-001	Control Circuit Devices and Switching Elements Electromechanical Control Circuit	
Federal State Institute VNIIPO	GOST R C-US.ПБ01.В02201	Safety Requirements for a Heat Detector	Federal State Institute VNIIPO
Korean	14-KB4BO-0749U	Fire/Overheat Detector Ex nC IIC	Korean

PART NUMBERS AND TEMPERATURE SETTINGS

Fenwal P/N	Setting*,**	Color
17343-124	140°F	None
17343-124	325°F	Red
17343-124	425°F	Green
17343-124	600°F	Orange
17343-124	725°F	Gray
* Specify heat setting when ordering. **All temps. ± 25°F (± 13.89°C)		

CONSTRUCTION

Hermetically sealed switch with glass to metal seals.

Set Point Temperature	Max Continuous Ambient Temperature
140°F (60°C)	40°F (38°C)
325°F (163°C)	225°F (149°C)
600°F (316°C)	500°F (260°C)
725°F (385°C)	625°F (329°C)

Insulation Resistance	20 Megohm @ 500 Vdc, terminals to shell
Dielectric Strength	500 VAC, 1 minute, terminals to shell
Contact Rating	0.5 AMP at 125 Vdc

The following details are shown on a detector head:

- Customer Part Number
- Customer Code
- Part Number: **17343-124**
- Date Code: XXYY (where XX = year, YY = week)

HANDLING AND STORAGE

Take precautions to ensure that the shell and threads are not subject to damage.

INSTALLATION

Note: Local Authorities Having Jurisdiction (AHJ) should be consulted before installation.

1. The 17343-124 detector must be mounted into an IP 54 Rated enclosure that complies with the appropriate requirements for Equipment Group II Category 3 applications. Enclosures must have a 3/4 NPT opening to mount the detector.
2. Thread the unit into the 3/4 NPT opening at least 5 full turns and torque to 20 foot pounds (27 N m).
3. Ensure that enclosures are grounded.
4. Connect system wiring to the detector's terminals per applicable electrical codes using 8-32 UNC 2A stainless steel slotted hex head screws with integral washer (provided).

OUTLINE DRAWING FOR 17343-124

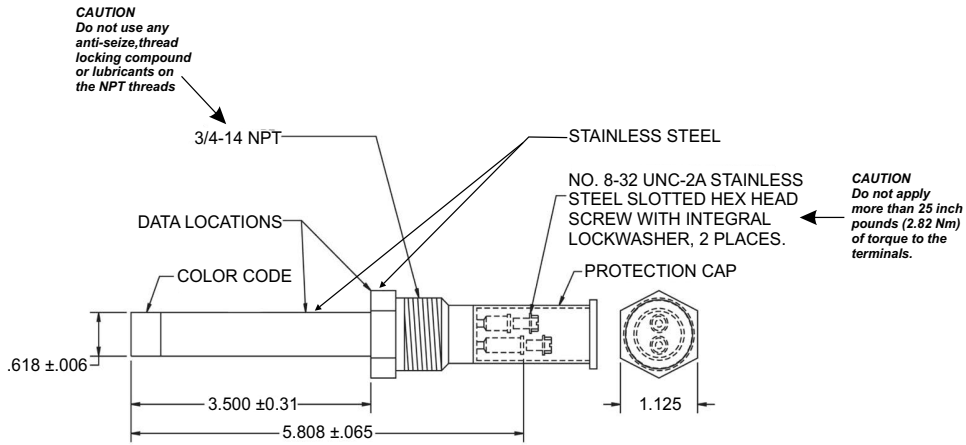


Figure 1. Fire/Overheat Detector

OPTIONAL OFFERING: EXPLOSION PROOF BOX ASSEMBLY

The Explosion Proof Box Assembly includes part number 17343-124 Heat Detector and Field wire Terminal housing. The Explosion Proof Box Assembly is available in right hand option (03-017343-127) and left hand option (03-017343-126) as shown in Figure 2 below.

The Assembly 03-017343-127 / 03 017343-126 is designed for installation in potentially explosive atmospheres and is certified with the following ratings:



II 3 G Ex nA nC IIC T3 Gc
IEC Ex ETL 12.0015X
-20°C ≤ Ta ≤ 198°C
ITS12ATEX47636X



Korean Cert # 14-KB4BO-0668X
Ex nC IIC T3



Note: For more requirements please refer to Series 03-017343-12X Installation Instructions for Fire/Overheat Detector Assembly.

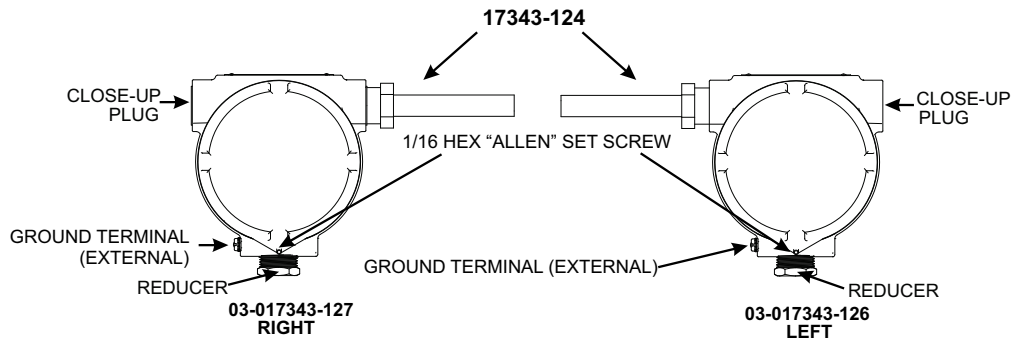


Figure 2. Explosion Proof Box Outline Drawing for 17343-126/127

EXPORT INFORMATION (USA)

Jurisdiction: EAR
Classification: EAR99

This document contains technical data subject to the EAR.

This literature is provided for informational purposes only. Kidde-Fenwal, LLC believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. Kidde-Fenwal, LLC assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, LLC, Ashland, MA 01721.

fenwalcontrols.com
508.881.2000

Kidde Fire Systems, Kidde Fire Protection and Fenwal Controls branded products are created exclusively by Kidde-Fenwal, LLC. All trademarks are the property of their respective owners. All products are the property of their respective owners.



400 Main Street, Ashland, MA 01721
P/N: F-03-001 Rev. Rev AD | kiddefenwal.com | 508-881-2000
2025© Kidde-Fenwal LLC | All Rights Reserved